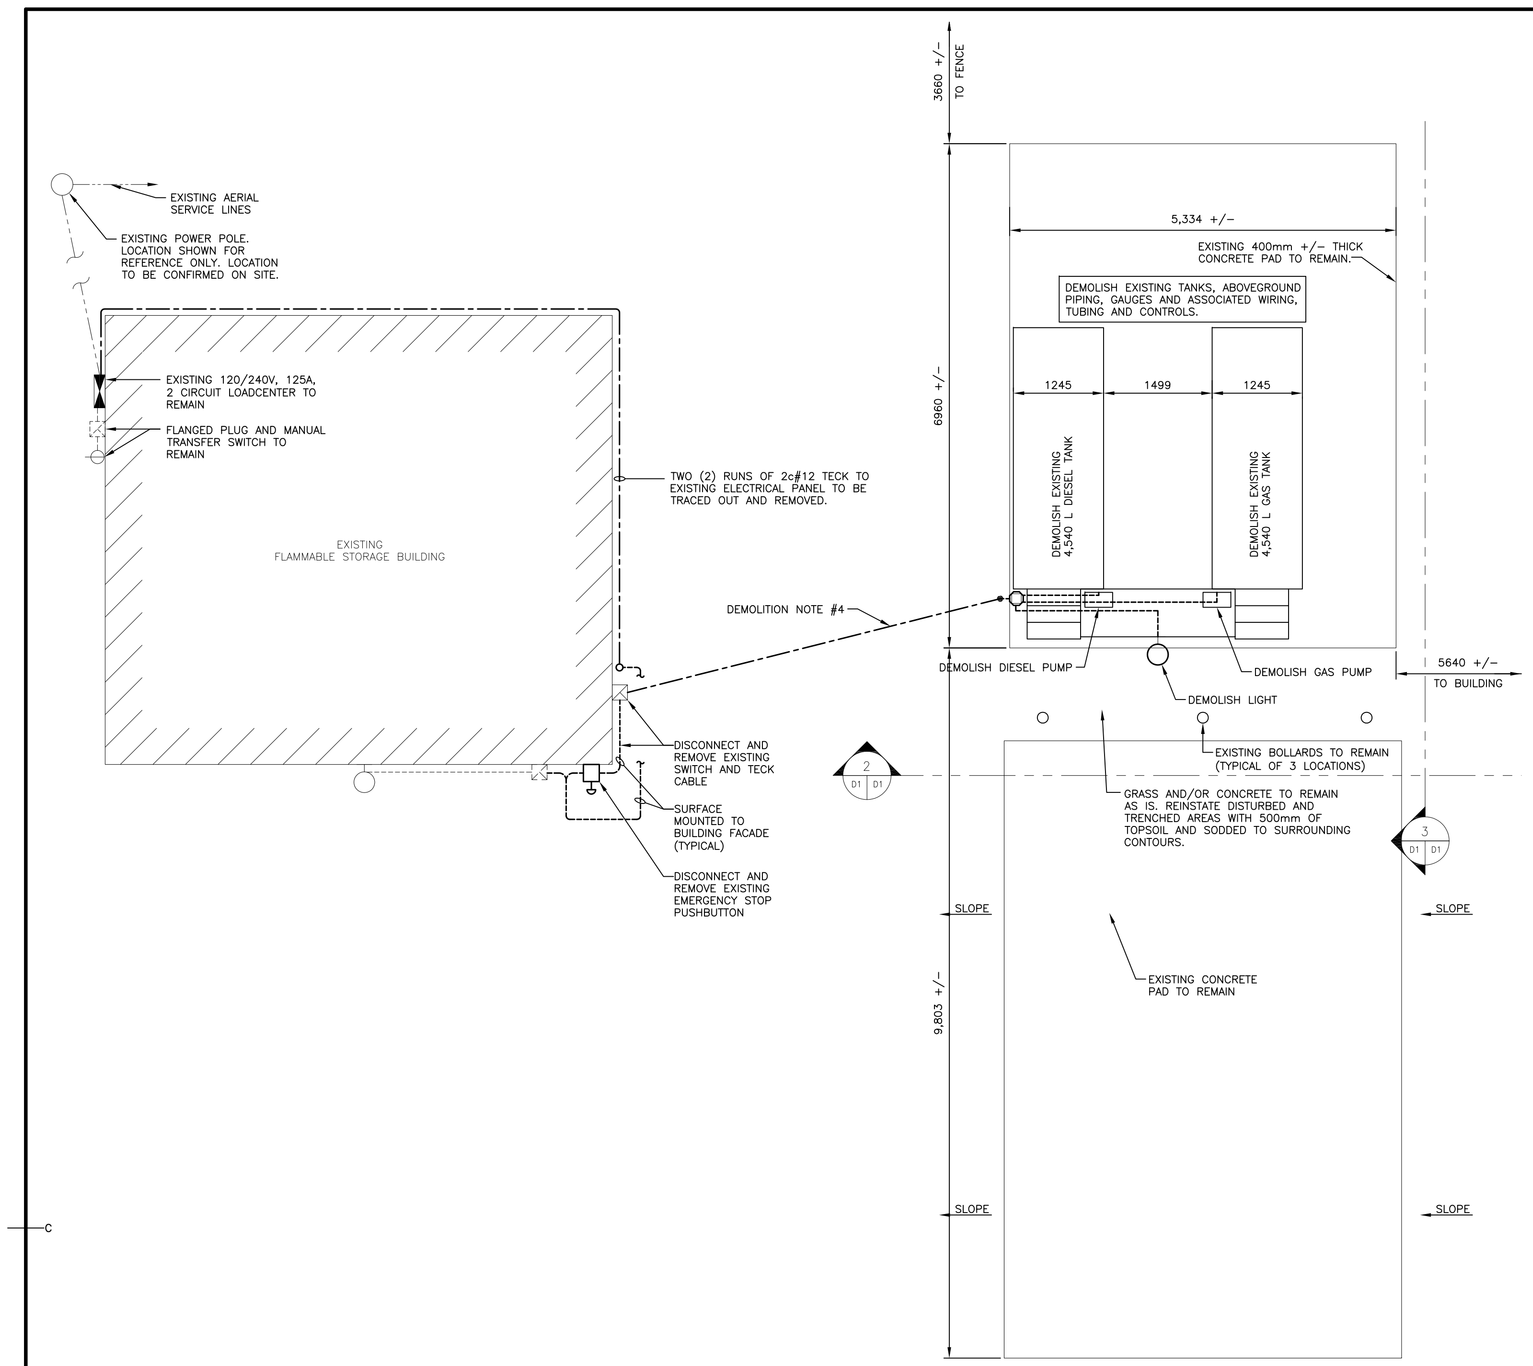

EXISTING PLAN VIEW 1 D1 D1

SCALE/ÉCHELLE: 1:50

0m 1m 2m 3m 4m 5m

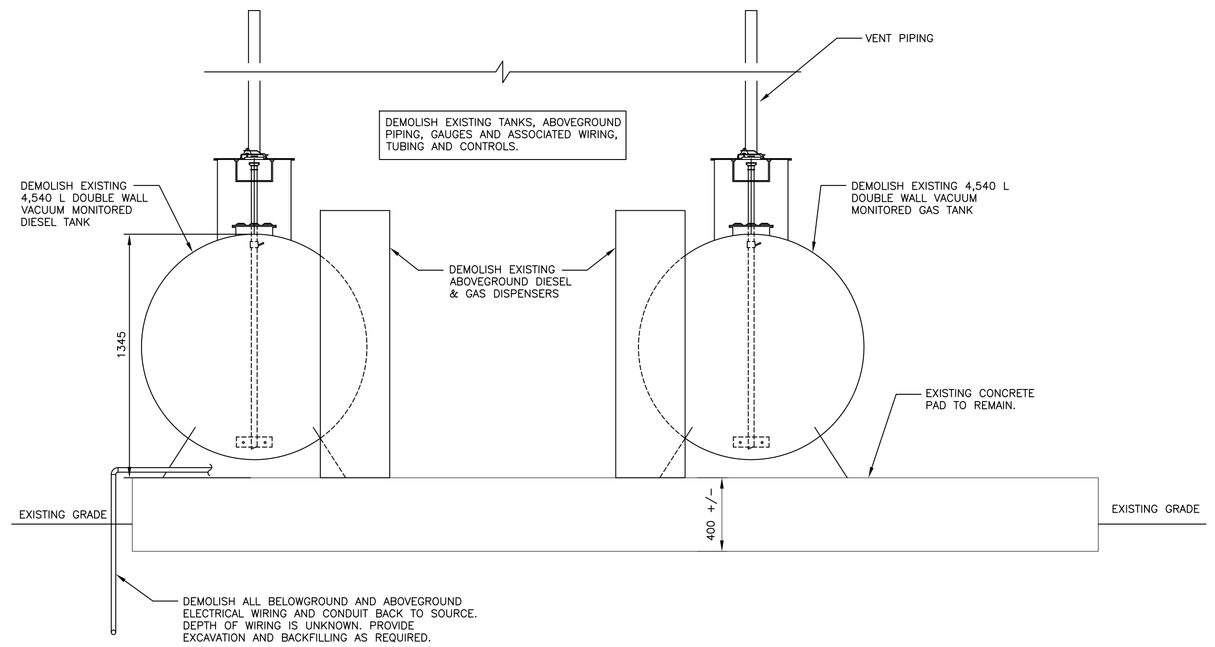

EXISTING A/G FUEL TANKS AND ELEVATION 2 D1 D1

SCALE : 1:20

0mm 500mm 1000mm 1500mm 2000mm 2500mm

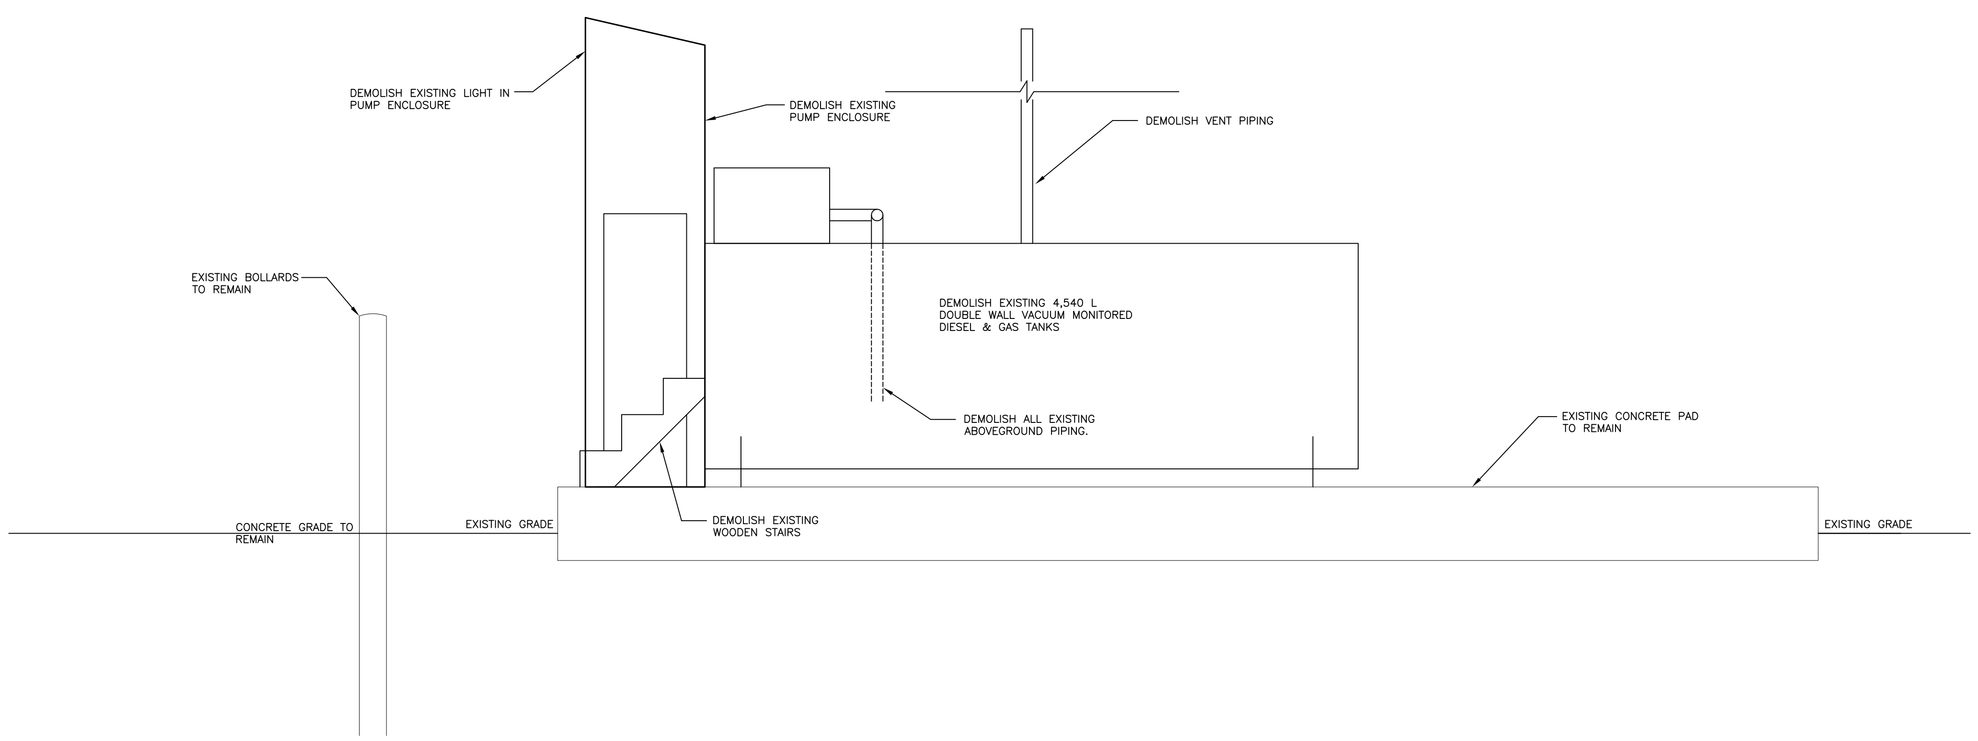

EXISTING A/G FUEL TANKS AND PUMP ELEVATION 3 D1 D1

SCALE : 1:20

0mm 500mm 1000mm 1500mm 2000mm 2500mm

DEMOLITION NOTES:

1. CONTRACTOR SHALL PROVIDE COMPLETE DEMOLITION OF EXISTING FUEL SYSTEM INCLUDING BUT NOT LIMITED TO TWO (2) FUEL TANKS, ALL ABOVE GROUND PIPING, TWO (2) FUEL PUMPS, WOODEN PUMP ENCLOSURE. CONTRACTOR TO PROVIDE DOCUMENTED RECORDS OF APPROVED DISPOSAL OF ALL EQUIPMENT.
2. CONTRACTOR TO COMPLY WITH ALL PROVINCIAL AND FEDERAL ENVIRONMENTAL REGULATIONS & PROVIDE ALL NECESSARY ENVIRONMENTAL PROTECTION.
3. CONTRACTOR RESPONSIBLE FOR COMPLETE DECOMMISSIONING OF EXISTING SYSTEM AS PER THE SPECIFICATION.
4. DEMOLISH ALL ASSOCIATED ABOVEGROUND AND BELOWGROUND ELECTRICAL CONDUIT AND CABLING FROM THE TWO (2) FUEL PUMPS AND EXPLOSION PROOF LUMINAIRE LOCATED AT THE PUMPING STATION BACK TO THE SURFACE MOUNTED MANUAL MOTOR SWITCH LOCATED ON THE FLAMMABLE STORAGE BUILDING.
5. UNDERGROUND SERVICES MAY EXIST BENEATH THE SITE. PRIOR TO COMMENCING WORK, THE CONTRACTOR IS TO VERIFY THE EXACT LOCATION AND ELEVATIONS OF ALL EXISTING UTILITIES AND SERVICES (SHOWN OR NOT SHOWN ON DRAWINGS) IN THE FIELD WITHIN THE CONTRACT LIMIT. INFORMATION SHOWN ON PLANS IS APPROXIMATE ONLY.
6. EXERCISE CAUTION DURING EXCAVATION & PROTECT FACILITIES FROM DAMAGE. CONTRACTOR TO REPAIR DAMAGES AT NO COST TO THE OWNER. CONTACT UTILITIES BEFORE EXCAVATING. WORK SHALL BE CARRIED OUT TO THE SATISFACTION OF THE CONSULTANT, OWNER AND AUTHORITIES.
7. REPAIR & REINSTATE DISTURBED ASPHALT PAVEMENT, GRASSED & LANDSCAPED AREAS DAMAGED BY WORK OF CONTRACT INCLUDING ALL AREAS IMPACTED BEYOND LIMIT OF CONTRACT.
8. "REMOVE", "ABANDON" AND "DEMOLISH" MEANS REMOVE AND DISPOSE OF FROM SITE ACCORDING TO APPLICABLE REGULATIONS.
9. DRAIN ALL TANKS AND PIPING PRIOR TO START OF WORK. ALL TANKS, PIPING, OIL SLUDGE AND RESIDUE MUST BE DISPOSED IN AN ENVIRONMENTALLY ACCEPTABLE MANNER MEETING ALL LOCAL, PROVINCIAL AND FEDERAL REGULATIONS. CONTRACTOR TO PROVIDE DOCUMENTATION OF DISPOSAL OF TANKS TO BE REGISTERED WITH ENVIRONMENT CANADA.

GENERAL ELECTRICAL LEGEND	
———	BOLD LINEWEIGHT INDICATES NEW WORK
———	LIGHT LINEWEIGHT INDICATES EXISTING TO REMAIN
○	JUNCTION BOX
▮	EXISTING POWER PANEL AS NOTED
○H	LUMINAIRE, WALL MOUNTED
◀	DIRECT CONNECTION
⊠	MANUAL MOTOR SWITCH NEMA 4X RATED
—·—·—	UNDERGROUND WIRING
—·—·—	AERIAL WIRING
- - - - -	SURFACE MOUNTED WIRING
○———	WIRING UP
●———	WIRING DOWN
⊖	SINGLE FLANGED PLUG
□D	EMERGENCY PUSH BUTTON

GENERAL MECHANICAL LEGEND	
⊙	PIPE RISER / DROP
	ANTI SIPHON VALVE
	UNION
	CHECK VALVE
⋈	BALL VALVE
~	PIPE CONTINUATION
———	ABOVEGROUND FUEL PIPE
- - - - -	HIDDEN

Coles Associates
architecture, engineering, project management
Charlottetown, P.E.I., Canada, C1A 7L3
Phone (902) 368-2300 Fax (902) 566-3768
www.colesassociates.com

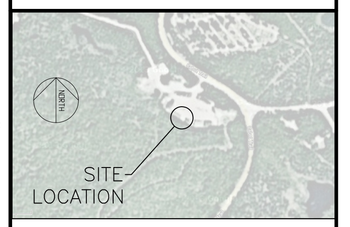

A detail no. no. du detail
B location drawing no. lieur dessin no.
C drawing no. dessin no.

2.	ISSUED FOR TENDER	2015/05/11
1.	ISSUED FOR 95% REVIEW	2015/3/25
revisions		date

project / projet

PARKS CANADA
FUEL SYSTEM
REPLACEMENT
INGONISH, NS

drawing / dessin

DEMOLITION PLAN

designed	AAP, EIT	conçu
date	2015-03-25	
drawn	AAP, EIT	dessiné
date	2015-03-25	
approved	SWW, P. ENG.	approuvé
date	2015-03-25	
Tender		Soumission
Parks Canada Departmental Representative		
project number		no. du projet
153001		
drawing no.		no. du dessin
D1		

1:1

0 10 20mm 40 60 80 100 120 140 160 180 200mm